

ARCHITECTURAL SYMBOLS	
	REVISION NUMBER - SHOWN ON PLANS
	POINT WHERE NEW CONNECTS TO EXISTING
	NUMBER OF DETAIL ON SHEET
	NUMBER OF SHEET WHERE DETAIL APPEARS
	KEYNOTE
	CONTINUATION SYMBOL
ROOM	
	ROOM NAME AND NUMBER
	INTERIOR ELEVATION TAG
	EXTERIOR ELEVATION TAG
	CALL OUT TAG
	SECTION TAG
	NORTH ARROW
	NORTH
FLOOR PLAN VIEW	
	SCALE
	NEW WORK IS SHOWN WITH SOLID HEAVY LINES.
	EXISTING TO REMAIN IS SHOWN WITH LIGHT LINES.
	DEMOLISHED WORK IS SHOWN WITH HEAVY DASHED LINES.
	EXISTING WALL TO REMAIN
	WALL TO BE REMOVED
	NEW WALL
E	EXISTING TO REMAIN
R	EXISTING TO BE RELOCATED
N	NEW TO BE INSTALLED

ARCHITECTURAL ABBREVIATIONS	
&	AND
@	AT
Ø	ROUND OR DIAMETER
L	ANGLE
LL	DOUBLE ANGLE
A&E	ARCHITECTURAL & ENGINEERING
AB	ANCHOR BOLT/ROD
ABV	ABOVE
ACT/ATC	ACOUSTICAL TILE CEILING
ADA	AMERICANS WITH DISABILITIES ACT
ADJ	ADJUSTABLE, ADJACENT, ADJOINING
AFF	ABOVE FINISHED FLOOR
ALT	ALTERNATE
ALUM	ALUMINUM
APC	ACOUSTICAL PANEL CEILING
APPROX	APPROXIMATE
ARCH	ARCHITECT (URAL)
AV	AUDIO VISUAL
BD	BOARD
BLDG	BUILDING
BLK	BLOCK (ING)
BM	BEAM
BOT	BOTTOM
BRG	BEARING
BTWN	BETWEEN
CAB	CABINET
CB	CERAMIC BASE
CG	CORNER GUARD
CJ	CONTROL / CONSTRUCTION JOINT
CL	CENTERLINE
CLG	CEILING
CLR	CLEAR, CLEARANCE
CMU	CONCRETE MASONRY UNIT
COL	COLUMN
CONC	CONCRETE
CONSTR	CONSTRUCTION
CONT	CONTINUOUS
COORD	COORDINATE
CPT	CARPET
CT	CERAMIC TILE
CTR	CENTER
DEMO	DEMOLITION, DEMOLISH
DET	DETAIL
DF	DRINKING FOUNTAIN
DIA	DIAMETER
DIAG	DIAGONAL
DIM	DIMENSION
DN	DOWN
DWG	DRAWING
DWTR	DUMBWAITER
EA	EACH
EJ	EXPANSION JOINT
EL	ELEVATION
ELEC	ELECTRICAL
ELEV	ELEVATOR
EQ	EQUAL
EQUIP	EQUIPMENT
EXIST	EXISTING
EXT	EXTERIOR
EWC	ELECTRIC WATER COOLER
FA	FIRE ALARM
FD	FLOOR DRAIN
FE	FIRE EXTINGUISHER
FEC	FIRE EXTINGUISHER CABINET
FIN	FINISH (ED)
FLR	FLOOR (ING)
FF&E	FURNITURE, FIXTURES & EQUIPMENT
GA	GAGE, GAUGE
GB	GRAB BAR
GALV	GALVANIZED
GWB	GYPSON WALL BOARD
HAZ MAT	HAZARDOUS MATERIAL
HM	HOLLOW METAL
HORIZ	HORIZONTAL
HT	HEIGHT
INCL	INCLUDE (D), INCLUDING
INSUL	INSULATION
INT	INTERIOR
JT	JOINT
LAM	LAMINATE (ED)
LAV	LAVATORY
LT	LIGHT
LVR	LOUVER
LVT	LUXURY VINYL TILE
MATL	MATERIAL
MAX	MAXIMUM
MECH	MECHANICAL
MEZZ	MEZZANINE
MFR	MANUFACTURER
MIN	MINIMUM
MISC	MISCELLANEOUS
MO	MASONRY OPENING
MTL	METAL
NA	NOT APPLICABLE
NOM	NOMINAL
NTS	NOT TO SCALE
OC	ON CENTER
OH	OVERHEAD
OPP	OPPOSITE
PERF	PERFORATED
PL / PLAM	PLASTIC LAMINATE
PLYWD	PLYWOOD
PNL	PANEL
PT	PAINT
PTD	PAINTED
PTN	PARTITION
PVC	POLYVINYL CHLORIDE
RF	RUBBER FLOORING
RCP	REFLECTED CEILING PLAN
REF	REFERENCE / REFRIGERATOR
REINF	REINFORCE (D), (ING)
REQD	REQUIRED
REV	REVISION (S), REVISED
RM	ROOM
RO	ROUGH OPENING
SC	SOLID CORE
SCHED	SCHEDULE
SCT	SECTION
SF	SQUARE FOOT
SHT	SHEET
SHTHG	SHEATHING
SIM	SIMILAR
SS	SOLID SURFACE
SST	STAINLESS STEEL
STD	STANDARD
STL	STEEL
STRUCT	STRUCTURAL
SUSP	SUSPENDED
SV	SHEET VINYL
SY	SQUARE YARD
T&G	TONGUE & GROOVE
TEMP	TEMPORARY
TER	TERRAZZO
THK	THICKNESS
THRU	THROUGH
TO	TOP OF
TOW	TOP OF WALL
TPTN	TOILET PARTITION
TYP	TYPICAL
UNO	UNLESS NOTED OTHERWISE
UTIL	UTILITY
VAR	VARIES
VCT	VINYL COMPOSITION TILE
VERT	VERTICAL
VIF	VERIFY IN FIELD
VWC	VINYL WALL COVERING
W/	WITH
W/O	WITHOUT
WB	WALL BASE
WD	WOOD
WDW	WINDOW
WG	WALL GUARD
WT	WEIGHT
XTG	EXISTING

*** NOTE ***
 ALL OF GENERAL NOTES ON THIS SHEET ARE TO BE APPLIED TO ALL OTHER MECHANICAL DRAWINGS IN THIS SET. SYMBOLS INDICATED HERE AND NOT USED IN THE CONTRACT DOCUMENTS DO NOT APPLY TO THIS PROJECT. ADDITIONAL SYMBOLS MAY BE INDICATED IN THE CONTRACT DOCUMENTS.

Drawn By: Author

Facilities Planning and Management
 Physical Plant - Architects/ Engineers
 30 N. Mills Street, Madison, WI 53715



Agency / Institution:
 University of Wisconsin-Madison



Project Title:
PROJECT NAME
ROOM NUMBERS
 Building Name & Number:
BUILDING NAME
UW BLDG. # BUILDING ID

Sheet Title:
SYMBOLS & ABBREVIATIONS

REVISIONS:			
No.	By:	Date:	Description:
Scale	1/4" = 1'-0"		
UW Number	1111 2222		
Set Type	SET TYPE		
Date Issued	ISSUE DATE		

A


GENERAL PLUMBING SYMBOLS

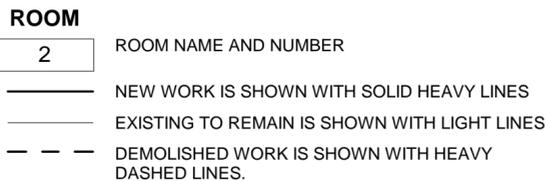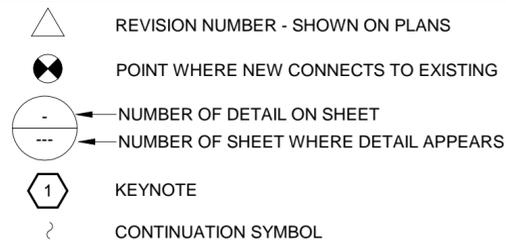


PLUMBING SYMBOLS

Table of plumbing symbols and abbreviations: DIRECTION OF FLOW, EXISTING PIPE TAG, PIPING BEING DEMOLISHED, NATURAL GAS, PROPANE GAS, DOMESTIC COLD WATER, etc.

PLUMBING SYMBOLS (CONTINUED)

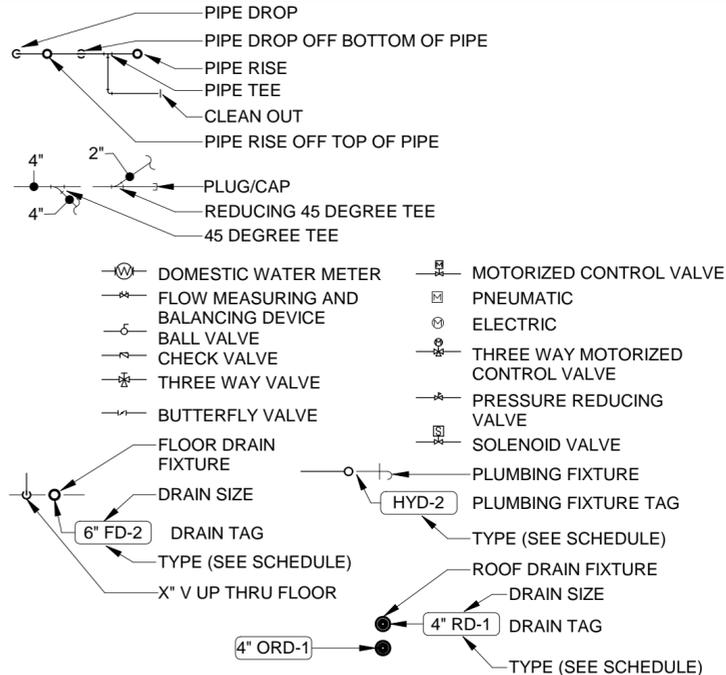

FIRE PROTECTION SYMBOLS

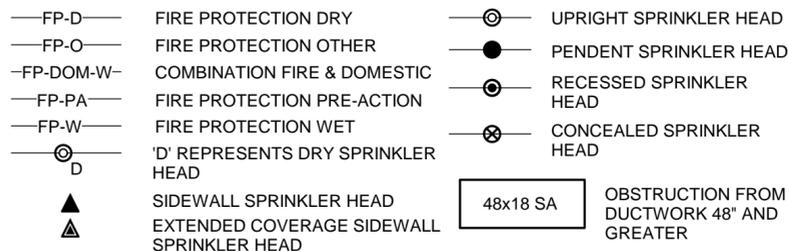

ABBREVIATIONS

Table of abbreviations: & AND, A AIR, ACOUS ACOUSTICAL, EQ EQUAL, EQUIP EQUIPMENT, EWC ELECTRIC WATER COOLER, etc.

ABBREVIATIONS (CONTINUED)

Table of abbreviations (continued): LB/HR POUNDS PER HOUR, LP LOW PRESSURE, LPG LIQUEFIED PETROLEUM GAS, etc.

EQUIPMENT ABBREVIATIONS

Table of equipment abbreviations: AS AIR SEPARATOR, B BOILER, CF CHEMICAL FEEDER, CFP CHEMICAL FEEDER PUMP, etc.

GENERAL NOTES

- 1 BOLDER TEXT AND GRAPHICS INDICATE NEW WORK. ALL OTHER TEXT AND GRAPHICS ARE EXISTING INFORMATION SHOWN FOR REFERENCE.
2 INSULATORS SHALL REPAIR OR REPLACE ALL INCIDENTALLY FOUND DAMAGED PIPE AND DUCT INSULATION AND JACKETS IN PROJECT AREA PER DSF MASTER SPECIFICATIONS AS NEEDED VIA MAINTENANCE WORK ORDER.
3 PLUMBING SHOP SHALL CHECK OPERATION OF ALL VALVES ASSOCIATED WITH PROJECT. REPAIR OR REPLACE DAMAGED VALVES AS NEEDED VIA MAINTENANCE WORK ORDER.
4 PLUMBING SHOP TO VERIFY ALL PLUMBING FIXTURES INCLUDING DRAINS IN PROJECT AREA ARE FUNCTIONING PROPERLY. REPAIR, CLEAN OR REPLACE AS REQUIRED UNDER MAINTENANCE WORK ORDER.
5 LABEL ALL PIPING, NEW AND EXISTING, PER DSF MASTER SPECIFICATIONS.
6 THOROUGHLY CLEAN ITEMS BEFORE INSTALLATION. CAP PIPE OPENINGS TO DEFLECT DEBRIS UNTIL FIXTURES ARE INSTALLED AND FINAL CONNECTIONS HAVE BEEN MADE.
7 PROVIDE AND INSTALL PIPING EQUIPMENT AND MATERIALS IN ACCORDANCE WITH APPLICABLE PLUMBING CODE REGULATIONS AND STANDARDS, AUTHORITIES HAVING JURISDICTION, AND AS OTHERWISE RECOMMENDED OR DIRECTED BY MANUFACTURERS.

NOTE ALL OF GENERAL NOTES ON THIS SHEET ARE TO BE APPLIED TO ALL OTHER MECHANICAL DRAWINGS IN THIS SET. SYMBOLS INDICATED HERE AND NOT USED IN THE CONTRACT DOCUMENTS DO NOT APPLY TO THIS PROJECT. ADDITIONAL SYMBOLS MAY BE INDICATED IN THE CONTRACT DOCUMENTS.

Drawn By: Author

Facilities Planning and Management
Physical Plant - Architects/ Engineers
30 N. Mills Street, Madison, WI 53715



Agency / Institution: University of Wisconsin-Madison

Project Title: PROJECT NAME
ROOM NUMBERS
Building Name & Number: BUILDING NAME
UW BLDG. # BUILDING ID

Sheet Title: SYMBOLS & ABBREVIATIONS, GENERAL NOTES


REVISIONS:

Table with columns: No., By, Date, Description. Includes a scale note: Scale 3/32" = 1'-0"


Table with columns: Uw Number, Set Type, Date Issued. Values: 1111 2222, SET TYPE, ISSUE DATE

P


GENERAL MECHANICAL SYMBOLS

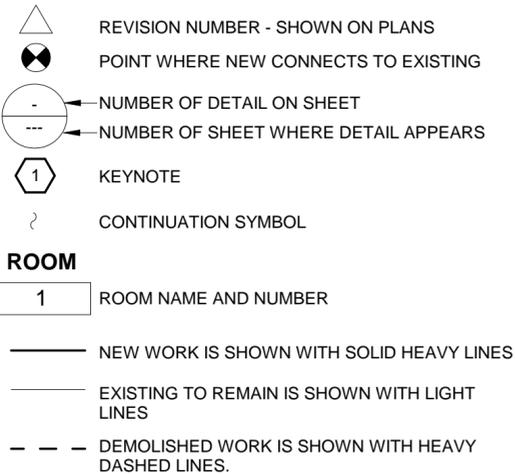


HVAC SYMBOLS

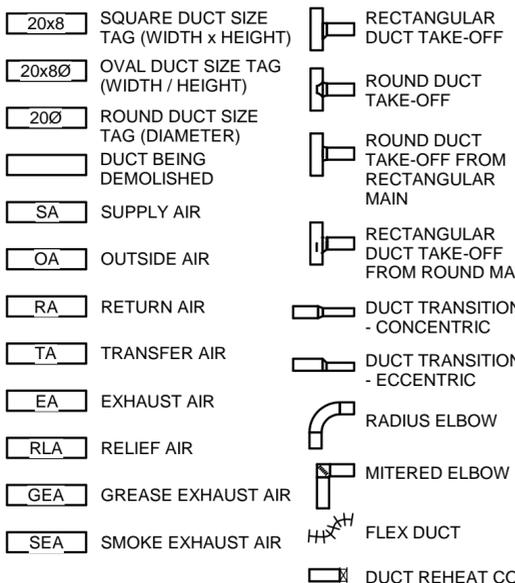

HVAC SYMBOLS (CONTINUED)

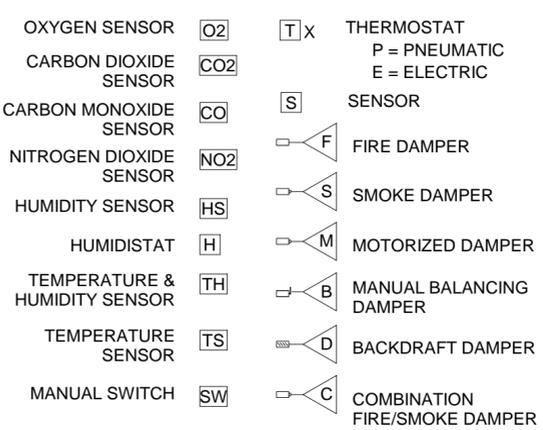

MECHANICAL PIPING SYMBOLS

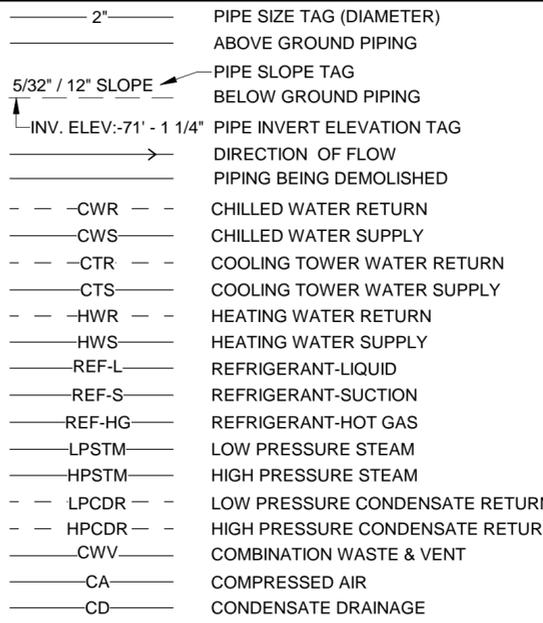

ABBREVIATIONS

Table of abbreviations including: AND, ROUND, AIR CONDITIONING, AIR COOLED CONDENSER, AIR COOLING CONDENSING UNIT, ACOUSTICAL, AIR FLOW MEASURING STATION, AIR HANDLING UNIT, ALUMINUM, ACCESS PANEL, AIR SEPARATOR, AIR TERMINAL UNIT, AUTOMATIC, BOILER, BELOW, BRITISH THERMAL UNITS, BRITISH THERMAL UNITS PER HOUR, CAPACITY, CABINET FAN, CHEMICAL FEEDER, CONSTANT FLOW CONTROL VALVE, CUBIC FEET PER MINUTE, CHEMICAL FEEDER PUMP, CHILLER, CHILLED WATER PUMP, CONCRETE, CONDENSATE, CONFERENCE, CONNECT, CONTRACT/CONTRACTOR, CONDENSATE RETURN UNIT, COOLING TOWER, CABINET UNIT HEATER, CUBIC FEET, CONSTANT VALVE, CONTROL VALVE, CHECK VALVE, CLOCKWISE, CONDENSER WATER PUMP, DEGREE, DRY BULB, DUCT MOUNTED COIL, DISCHARGE, DIVISION, DAMPER, DOWN, ENTERING AIR TEMPERATURE, ELECTRIC DUCT COIL, EXHAUST FAN, ELBOW, ELECTRICAL, EXPLOSION PROOF, EQUIPMENT, EXPANSION TANK, ENTERING WATER TEMPERATURE, EXHAUST AIR, EXHAUST HOOD, EXISTING, EXPANSION, EXPANSION JOINT, EXTERIOR, DEGREES FAHRENHEIT, FAN COIL UNIT, FIRE DAMPER, FLEXIBLE, FLANGE, FUEL OIL, FUEL OIL VENT, FUEL OIL RETURN, FUEL OIL SUPPLY, FEET PER MINUTE, FOOT/FEET, FIN TUBE RADIATION, GAGE/GAUGE, GALLON, GALVANIZED, GENERAL CONTRACTOR, GENERATOR, GALLONS PER HOUR, GALLONS PER MINUTE, GRAVITY ROOF VENTILATOR, HUMIDIFIER, HORSE POWER, HIGH PRESSURE, HEAT PUMP UNIT, HEAT RECOVERY UNIT, HEATING, HEATER, HEATING WATER PUMP, HEAT EXCHANGER, INDIRECT, INLINE CENTRIFUGAL, INCH, INLET, INSULATION, INCHES WATER GAUGE, JOIST SPACE, JOINT, POUND, POUNDS PER HOUR.

* NOTE *
ALL OF GENERAL NOTES ON THIS SHEET ARE TO BE APPLIED TO ALL OTHER MECHANICAL DRAWINGS IN THIS SET. SYMBOLS INDICATED HERE AND NOT USED IN THE CONTRACT DOCUMENTS DO NOT APPLY TO THIS PROJECT. ADDITIONAL SYMBOLS MAY BE INDICATED IN THE CONTRACT DOCUMENTS.

GENERAL NOTES

- 1 BOLDER TEXT AND GRAPHICS INDICATES NEW WORK. ALL OTHER TEXT AND GRAPHICS IS EXISTING INFORMATION SHOWN FOR REFERENCE.
- 2 NEW DUCTWORK SHALL BE INSTALLED PER SMACNA AND ALL STATE CODES. DUCTWORK SHALL BE SEALED AT ALL JOINTS, TRANSVERSE AND LONGITUDINAL SEAMS AND CONNECTIONS IN DUCTWORK. THE REFERENCED DUCTWORK INCLUDES ALL SUPPLY, EXHAUST, AND RETURN DUCTS. CONCEALED SUPPLY AIR DUCTWORK SHALL BE INSULATED WITH FLEXIBLE FIBERGLASS (MIN. 5.0 R). EXPOSED SUPPLY AIR DUCTWORK, OUTSIDE OF THE ROOM IT SERVES SHALL BE INSULATED WITH RIGID FIBERGLASS (MIN. 5.0 R) OR SHALL BE DOUBLE-WALL DUCT WITH MINIMUM 5.0 R INSULATION. EXPOSED SUPPLY AIR DUCTWORK DOWNSTREAM OF THE REHEAT COIL AND WITHIN THE ROOM IT SERVES DOES NOT REQUIRE INSULATION.
- 2.1 NEW DUCTWORK SHALL BE INSTALLED PER SMACNA AND ALL STATE CODES. DUCTWORK SHALL BE SEALED AT ALL JOINTS, TRANSVERSE AND LONGITUDINAL SEAMS AND CONNECTIONS IN DUCTWORK. THE REFERENCED DUCTWORK INCLUDES ALL SUPPLY, EXHAUST, AND RETURN DUCTS. CONCEALED SUPPLY AIR DUCTWORK SHALL BE INSULATED WITH FLEXIBLE FIBERGLASS (MIN. 5.0 R). EXPOSED SUPPLY AIR DUCTWORK, OUTSIDE OF THE ROOM IT SERVES SHALL BE INSULATED WITH RIGID FIBERGLASS (MIN. 5.0 R) OR SHALL BE DOUBLE-WALL DUCT WITH MINIMUM 5.0 R INSULATION. EXPOSED SUPPLY AIR DUCTWORK DOWNSTREAM OF THE REHEAT COIL AND WITHIN THE ROOM IT SERVES DOES NOT REQUIRE INSULATION. DUCTWORK EXTERIOR TO THE BUILDING, OUTSIDE AIR DUCTWORK AND OTHER DUCTWORK WITH INTERNAL TEMPERATURES BELOW 40 DEGREES FAHRENHEIT SHALL HAVE RIGID FIBERGLASS OR INSULATED DOUBLE-WALL CONSTRUCTION WITH MINIMUM 8.0 R INSULATION. DUCTWORK EXTERIOR TO THE BUILDING SHALL HAVE WEATHER-PROOF JACKET. DOUBLE-WALL DUCTWORK SHALL HAVE SOLID METAL LINER UNLESS DRAWINGS INDICATE OTHERWISE.
- 3 THE MAXIMUM LENGTH FOR EACH SECTION OF FLEXIBLE DUCT SHALL BE 5'-0". ALL BENDS IN FLEXIBLE DUCT SHALL HAVE A MINIMUM RADIUS OF 1.5 DUCT DIAMETERS TO DUCT CENTERLINE.
- 4 LABEL ALL PIPING NEW AND EXISTING PER DFD MASTER SPECIFICATIONS.
- 5 STEAMFITTERS OR DIGITAL CONTROLS GROUP SHALL RECALIBRATE OR REPLACE EXISTING THERMOSTATS AS APPROPRIATE.
- 6 BALANCE HVAC AIR AND FLUID SYSTEMS TO QUANTITIES SHOWN ON PLANS AND/OR SCHEDULES. SEND BALANCE REPORTS TO ENGINEER AND MAKE AVAILABLE TO THE DEPARTMENT OF SAFETY & BUILDINGS UPON REQUEST.
- 7 MAINTENANCE MECHANIC SHALL CLEAN ALL SUPPLY, RETURN, EXHAUST, TRANSFER AND DOOR GRILLES AS NEEDED VIA MAINTENANCE WORK ORDER.
- 8 INSULATION & JACKETS DAMAGED DURING OR AS A RESULT OF PROJECT WORK SHALL BE REPAIRED OR REPLACED UNDER PROJECT WORK ORDER.
- 9 MAINTENANCE MECHANIC TO CLEAN ALL EXISTING COILS AS NEEDED VIA MAINTENANCE WORK ORDER. SHEETMETAL TO INSTALL ACCESS DOORS WHERE REQUIRED ON ALL EXISTING COILS VIA MAINTENANCE WORK ORDER.
- 10 MAINTENANCE MECHANIC TO CLEAN ALL EXISTING CONVECTORS AND FAN COIL UNITS AS NEEDED VIA MAINTENANCE WORK ORDER. STEAMFITTERS TO REPAIR/REPLACE/ADJUST ASSOCIATED CONTROL VALVES AND DAMPERS AS NEEDED VIA MAINTENANCE WORK ORDER.
- 11 STEAMFITTERS TO CHECK OPERATION OF CONTROLS ASSOCIATED WITH REMODEL, UNDER PROJECT WORK ORDER.
- 12 ALL NEW DUCTWORK ASSOCIATED WITH FUME HOODS SHALL BE PVS COATED ON ALL SURFACES EXPOSED TO AIR STREAM.

Project Title:
PROJECT NAME
ROOM NUMBERS
Building Name & Number:
BUILDING NAME
UW BLDG. # BUILDING ID

REVISIONS:
No. By: Date: Description:

Scale 3/32" = 1'-0"

UW Number 1111 2222

Set Type SET TYPE

Date Issued ISSUE DATE

M



REVISIONS:

No.	By:	Date:	Description:

Scale 1/4" = 1'-0"

UW Number 1111 2222

Set Type SET TYPE

Date Issued ISSUE DATE



GENERAL NOTES

- ADJUST LOCATIONS AS NEEDED. DEVICES ARE SHOWN ON PLANS IN APPROXIMATE IDEAL LOCATIONS, UNLESS SPECIFICALLY DIMENSIONED.
- OPEN WALLS AS NEEDED TO ALLOW FOR NEW ELECTRICAL INSTALLATIONS.
- LABEL ALL CIRCUITS ON JUNCTION BOXES, RECEPTACLES, DATA, FIRE ALARM, AND EQUIPMENT IN SCOPE OF PROJECT.
- UPDATE ALL PANEL SCHEDULES IN SCOPE OF PROJECT.
- INSTALL RACEWAY AS NEEDED FOR DDC, ACCESS CONTROL, LOW VOLTAGE WIRING & DATA.
- PLACE ARC FLASH LABEL ON PANELS THAT ARE IN SCOPE OF PROJECT.
- FIRE ALARM CONTRACTOR TO REPROGRAM ANY NEEDED CHANGES TO FIRE ALARM SYSTEM.
- RESEAL FIRE AND SMOKE WALL PENETRATIONS AS NEEDED WITH APPROPRIATE MATERIALS.
- RELABEL POWER, DATA & FIRE ALARM FOR ROOM # CHANGES.
- VERIFY ALL CIRCUITS LABELED ON PRINT ARE CORRECT BEFORE WORKING ON THEM.
- GENERAL HOUSEKEEPING IS THE RESPONSIBILITY OF EACH TRADE AFTER THE PERFORMANCE OF THEIR WORK.
- NOTE ON SITE PLAN – ALL CHANGES OR MISSING DETAIL TO BE INCORPORATED INTO THE MASTER PLAN.

LIGHTING SYMBOLS

- TYPE ← PANEL NAME
- CIRC. # ← CIRCUIT/SWITCH
- 2X4 RECESSED GRID LIGHT FIXTURE
 - EMERGENCY 2X4 RECESSED GRID LIGHT FIXTURE
 - 2X4 RECESSED GRID LIGHT FIXTURE
 - EMERGENCY 2X4 RECESSED GRID LIGHT FIXTURE
 - 1X4 RECESSED GRID LIGHT FIXTURE
 - EMERGENCY 1X4 RECESSED GRID LIGHT FIXTURE
 - 1X4 SURFACE GRID LIGHT FIXTURE
 - EMERGENCY 1X4 SURFACE GRID LIGHT FIXTURE
 - PENDANT LIGHT FIXTURE
 - EMERGENCY PENDANT LIGHT FIXTURE
 - TRACK LIGHT FIXTURE
 - UNDER CABINET LIGHT FIXTURE
 - RECESSED CAN LIGHT FIXTURE
 - EMERGENCY RECESSED CAN LIGHT FIXTURE
 - WALL PACK LIGHT FIXTURE
 - EMERGENCY WALL PACK LIGHT FIXTURE
 - CRITICAL WALL PACK LIGHT FIXTURE
 - EMERGENCY WALL PACK LIGHT FIXTURE
 - EXIT SIGN - CEILING
 - EXIT SIGN - WALL
 - SPOT LIGHT FIXTURE

ELECTRICAL EQUIPMENT SYMBOLS

- XXXX ← PANEL NAME
- PANELBOARD SURFACE
 - PANELBOARD RECESSED
 - MAIN DISTRIBUTION PANEL
 - LCP LIGHTING CONTROL PANEL
 - FUSED DISCONNECT
 - NON-FUSED DISCONNECT
 - XFMR TRANSFORMER
 - MOTOR
 - GROUND BAR
 - VFD
 - JUNCTION BOX - CEILING
 - JUNCTION BOX - WALL
 - THERMOSTAT
 - CLOCK
 - CEILING FAN
 - WALL FAN
 - WIREMOLD

COMMUNICATION / AUDIO VISUAL SYMBOLS

- DATA/DATA OUTLET - WALL
- DATA/DATA OUTLET - FLOOR
- DATA/DATA OUTLET - CEILING
- VOICE/DATA OUTLET - WALL
- VOICE/DATA OUTLET - FLOOR
- VOICE/DATA OUTLET - CEILING
- PHONE JACK - WALL
- COAXIAL
- SPEAKER - CEILING
- SPEAKER - WALL
- AUDIO VISUAL SPEAKER
- AUDIO VISUAL
- WIRELESS ACCESS POINT
- PANDUIT

FIRE ALARMS

- HEAT DETECTOR
- SMOKE DETECTOR
- FIRE ALARM STROBE - CEILING
- FIRE ALARM SPEAKER - CEILING
- FIRE ALARM STROBE - WALL
- FIRE ALARM SPEAKER - WALL
- FIRE ALARM SPEAKER-STROBE - CEILING
- FIRE ALARM SPEAKER-STROBE - WALL
- FIRE DOOR HOLD/RELEASE
- FIRE BEAM DETECTOR
- FIRE PULL STATION
- FIRE CONTROL RELAY
- FIRE DUCT DETECTOR
- FIRE ALARM TEST SWITCH
- FACP PANEL
- NAC PANEL

SECURITY

- CARD READER
- DOOR POSITION SWITCH
- REQUEST TO EXIT
- PUSH BUTTON
- DOOR OPERATOR
- POWER SUPPLY

SWITCHES

- CIRCUIT
- MULTI-WAY SWITCH
- SINGLE SWITCH
- TWO GANG SWITCH
- THREE GANG SWITCH
- FOUR GANG SWITCH
- DIMMER SWITCH
- FAN SWITCH
- KEYED SWITCH
- LOW VOLTAGE SWITCH
- OCCUPANCY SENSOR SWITCH
- OCCUPANCY SENSOR
- DAYLIGHT SENSOR

GENERAL ELECTRICAL SYMBOLS

- REVISION NUMBER - SHOWN ON PLANS
- NUMBER OF DETAIL ON SHEET
- NUMBER OF SHEET WHERE DETAIL APPEARS
- KEYNOTE
- CONTINUATION SYMBOL
- ROOM
- ROOM NAME AND NUMBER
- NEW WORK IS SHOWN WITH SOLID HEAVY LINES
- EXISTING TO REMAIN IS SHOWN WITH LIGHT LINES
- DEMOLISHED WORK IS SHOWN WITH HEAVY DASHED LINES.

RECEPTACLES SYMBOLS

- SINGLE RECEPTACLE
- DUPLEX RECEPTACLE
- EMERGENCY DUPLEX RECEPTACLE
- GFCI DUPLEX RECEPTACLE
- DOUBLE DUPLEX RECEPTACLE
- EMERGENCY DOUBLE DUPLEX RECEPTACLE
- GFCI DOUBLE DUPLEX RECEPTACLE
- DUPLEX CEILING RECEPTACLE
- EMERGENCY DUPLEX CEILING RECEPTACLE
- DUPLEX FLOOR RECEPTACLE
- EMERGENCY DUPLEX FLOOR RECEPTACLE
- 208 SINGLE PHASE OUTLET
- 208 THREE PHASE OUTLET
- EMERGENCY 208 SINGLE PHASE OUTLET
- EMERGENCY 208 THREE PHASE OUTLET
- USB
- FLOOR BOX POWER
- FLOOR BOX POWER / DATA

